



PINAL COUNTY
wide open opportunity

SPECIFICATIONS FOR

Carports

PINAL COUNTY BUILDING SAFETY DEPARTMENT
P.O. BOX 1610, FLORENCE, AZ. 85132
31 N. PINAL STREET, BLDG. F
(520) 866-6405 FAX (520) 866-6517

www.pinalcountyz.gov

INFORMATION
BULLETIN

007

November 2010

This information bulletin describes the minimum requirements for obtaining carport permits for residential buildings. Please reference Bulletin 003 (Permit Exemptions) to determine whether your project requires a building permit. The minimum requirements for a carport plan submittal are attached for your use. If your project exceeds the attached details, please provide two sets of drawings specific to your project.

I. DEFINITION

A carport is a motor vehicle storage structure accessory to a single family dwelling or duplex. It may be freestanding or attached to another structure. A carport one story in height must be entirely open on at least two sides except for structural supports. There can be no enclosed use above a carport. Any structure which does not comply with the above definition must comply with all regulations relating to a garage.

II. DRAWINGS TO PROVIDE & FORMS TO COMPLETE

Plans must be drawn to scale and must be of sufficient clarity to indicate the location, nature and extent of the work proposed. Be sure to clearly label all existing and proposed construction.

Plans must show, in detail that the proposed work will conform to the provisions of the 2006 International Building Code, Zoning Ordinances and all other relevant laws, ordinances, rules and regulations.

Two sets of plans are required and must include:

- A. Plot Plan**
See attached example.
- B. Foundation and Framing Plans**
A foundation plan, roof framing plan, elevations, cross sections, and connection details are needed for review.
- C. Permit Application**
All projects must be submitted with a completed Building Permit Application that can be found under Forms on our website.

III. CONSTRUCTION SPECIFICATIONS

Following are the minimum construction specifications for carports.

A. Lumber must be Douglas fir-larch No.2 or better. All lumber must be grade marked. Joists, girders and posts may be required to be protected against termites. (See Section R320 of the International Residential Code (IRC) for details.) All posts must be at least 4x4.

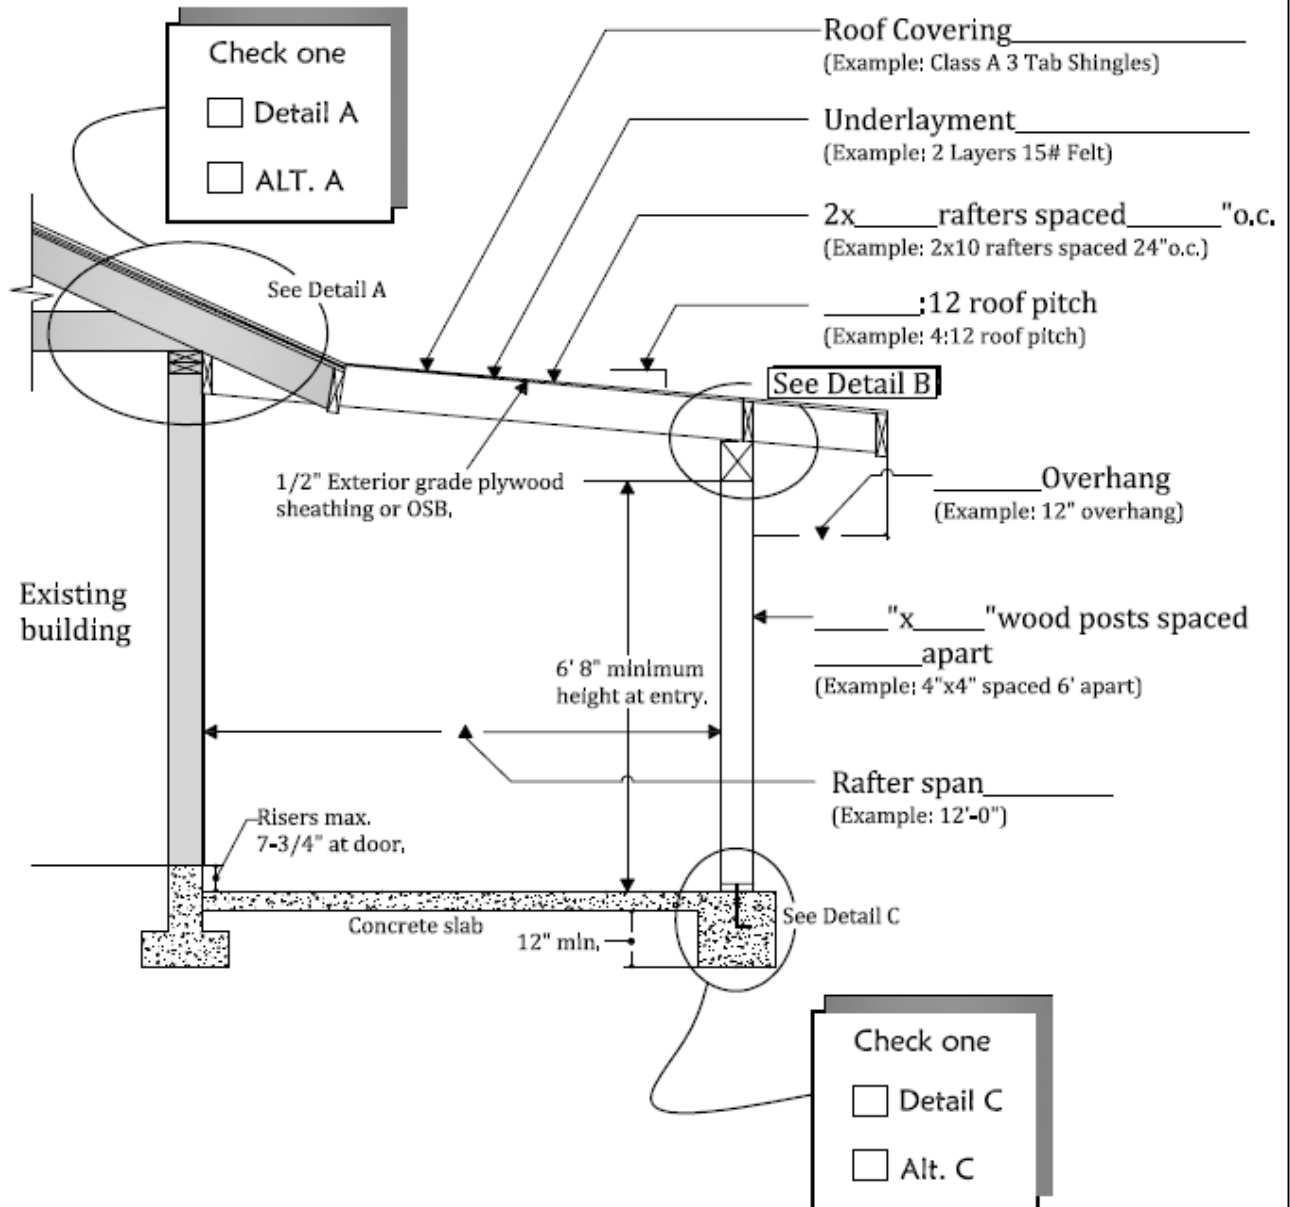
B. The post anchorage and bracing details shown on the following sheets have been approved by Pinal County for unenclosed carports.

1. Posts must be anchored at the lower end and must be braced at the upper end using any of the details provided. Decorative-type bracing may be substituted if the same resistance to lateral loading is provided.

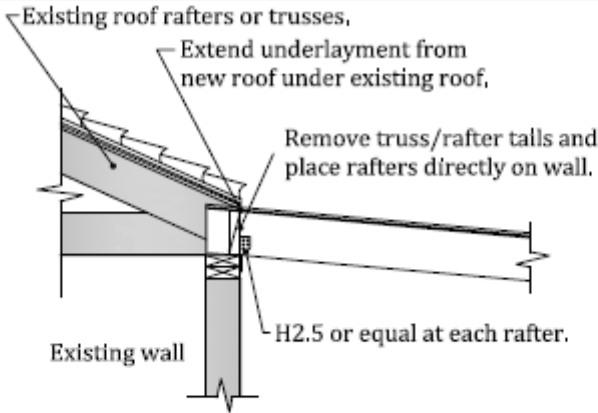
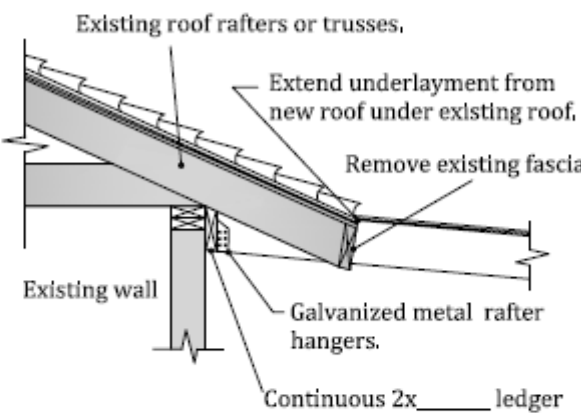
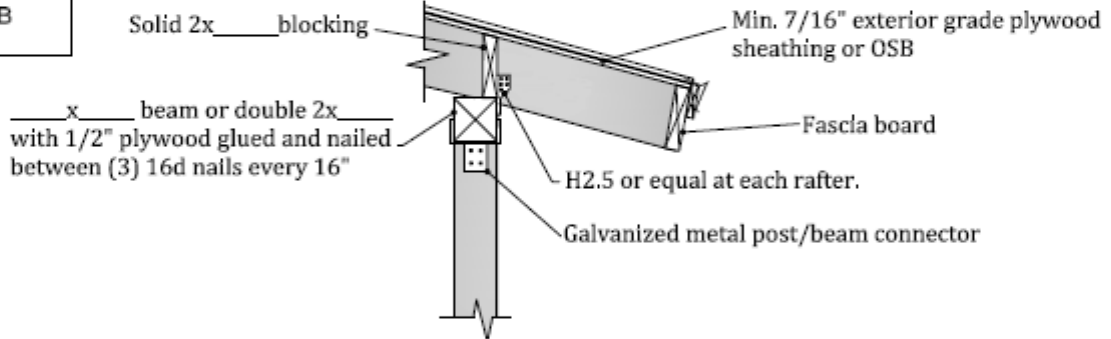
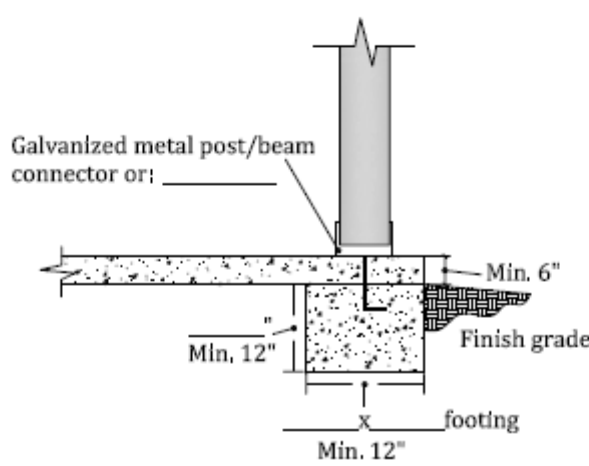
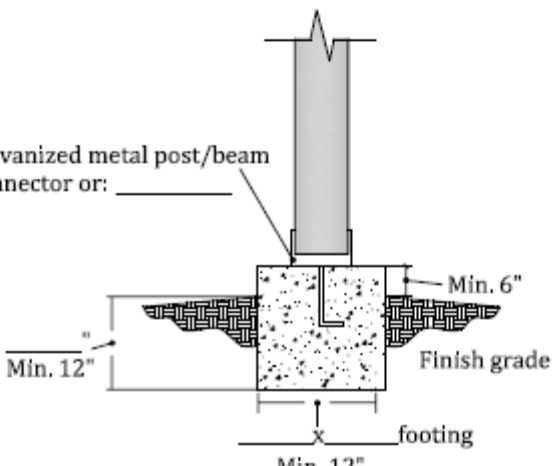
2. Carports with roofing and/or enclosed walls must be designed in accordance with the requirements of IRC Section R305.1 and Chapter 16 of the International Building Code.

C. When it is desired to connect and support one side of the carport structure by attaching it directly to the house, the rafter spacing and beam sizes may be as shown in the Tables provided. The main beam may be replaced on the side attached to the dwelling unit with a ledger the same size as the rafters and fastened to the studs with 3/8" x 5" lag screws spaced at 32" maximum on center for up to a 10' rafter span. Lag screws may be spaced at 16" on center when the rafter span does not exceed 20'. Attaching the rafters to existing dwelling unit rafters is not recommended. If a ledger beam is not used, rafters should be notched and placed directly on the double top plate of the dwelling unit wall.

Fill in the blanks with dimensions and materials which will be used to build your project. Please print legibly. Details provided on page 3.



Fill in the blanks with dimensions and materials which will be used to build your project.
Please print legibly.

PATIO ROOF ON WALL	DETAIL A	ALT. A	PATIO ROOF W/ LEDGER BOARD
		<p>NOTE: Remove wall finish where ledger occurs</p> 	
DETAIL B			
POST FOOTING WITH SLAB	DETAIL C	ALT. C	POST FOOTING WITHOUT SLAB
			

IMPORTANT NOTES

1. Beam table bases on maximum rafter span of 12 feet with 12" overhang.
2. All lumber to be Doug-Fir #2 or better.
3. Beams are to be joined together with 3 non-corrosive 16d nails or 3-3" deck screws every 16" on center or equal.
4. All splices in beam members must occur over support posts.
5. All wood parts must be at least 6" above finish grade or be constructed of pressure treated wood.
6. House structure which is cantilevered (i.e. fascia board) cannot be used for support of patio/carport roof/cover structure. **ROOFS SHALL NOT BE ATTACHED TO MANUFACTURED HOMES, MUST BE SELF SUPPORTING.**
7. For other options please call the building department.

BEAM TABLE

BEAM SIZE	MAXIMUM SPAN BETWEEN POSTS AND MIN. FOOTING SIZE	
(2) 2 x 6	7' (SPAN)	12" (FTG)
(2) 2 x 8	9' (SPAN)	14" (FTG)
(2) 2 x 10	11' (SPAN)	16" (FTG)
(2) 2 x 12	13' (SPAN)	18" (FTG)

ROOF RAFTER TABLE

(Based on a 20lb live load - 15lb dead load)

RAFTER SIZE	RAFTER SPACING	MAXIMUM SPAN
2 x 6	12" O.C.	13'-0"
	16" O.C.	12'-0"
	24" O.C.	10'-0"
2 x 8	12" O.C.	18'-0"
	16" O.C.	15'-6"
	24" O.C.	12'-6"
2 x 10	12" O.C.	22'-0"
	16" O.C.	19'-0"
	24" O.C.	15'-6"

PINAL COUNTY BUILDING SAFETY SELF SUPPORTING CARPORT

